


**NOTE:**

PRECAST STRUCTURE TO BE DESIGNED BY MANUFACTURER. SHOP DRAWINGS TO BE REVIEWED BY OWNER.

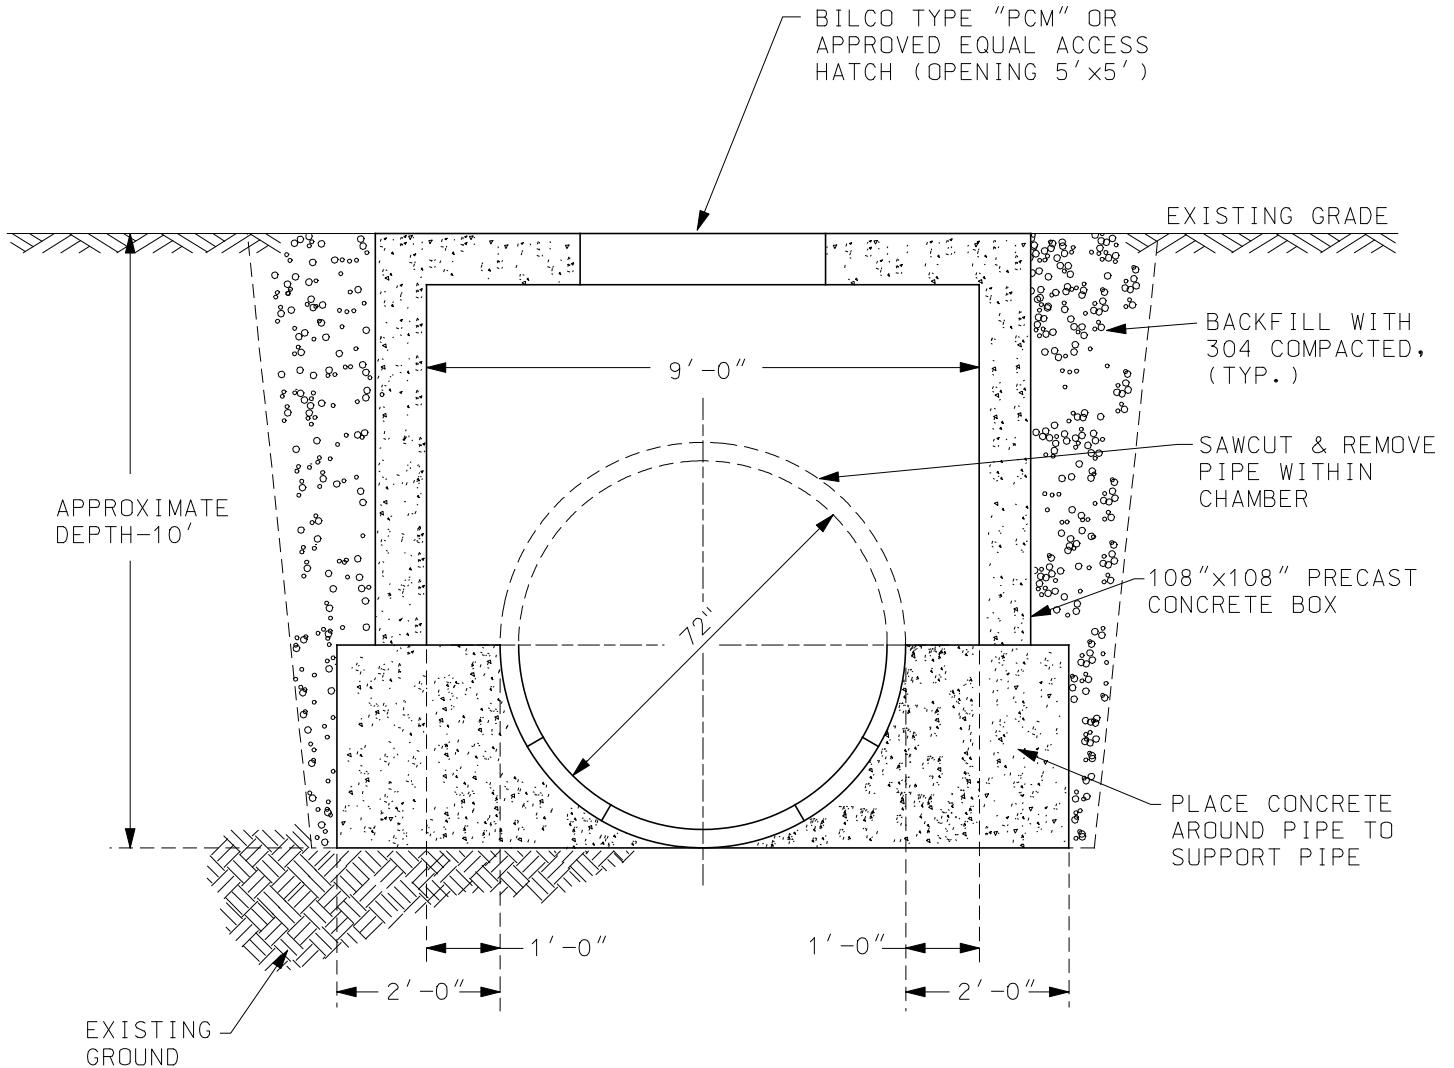

**DETAIL - 108" x 108" PRECAST STRUCTURE**

NO SCALE

**GENERAL NOTES:**

1. ALL MATERIAL, DESIGN, MANUFACTURE, PHYSICAL TEST REQUIREMENTS, FINISH MARKING, INSPECTION, REJECTION AND REPAIRS TO MEET "SPECIFICATION FOR PRECAST REINFORCED CONCRETE MANHOLE SECTIONS", PER ASTM C-478 (LATEST EDITION).
2. CONCRETE STRENGTH PER ASTM C-913.

NO.	DATE	REVISIONS

LUCILLE STORM PUMP STATION  
PROPOSED CHAMBER DETAIL

SCALE: NOT TO SCALE  
DRAWN: AUGUST 2009 BY: A.K.  
SHEET 2



320 W. MONUMENT AVE.  
DAYTON, OHIO 45402

**CITY OF DAYTON**  
**DEPARTMENT OF WATER**  
**DIVISION OF WATER ENGINEERING**

